


United Water - AOS  
1111 Nantasket Avenue  
Hull, Ma 02045-1313  
Tel # 781-925-0906  
Fax # 781-925-3056

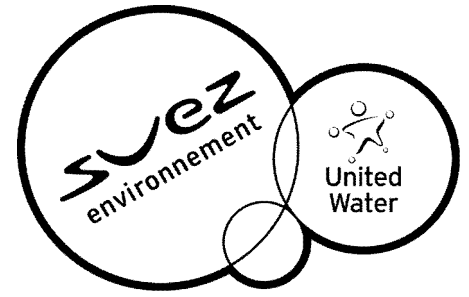

## **MONTHLY OPERATING REPORT**

### **February 2012**

#### **EXECUTIVE SUMMARY**

There were no odor reports in the month of February.

The RST discharge auger pump has been removed from service for repair. The supplier has informed us that this pump is no longer available so all parts will have to be fabricated to accomplish repair.

Station #9, pump #2 has been rebuilt. New shaft sleeve and seal have been installed, new bearings and a rebuilt motor were installed.

EIS, our instrumentation contractor, has provided annual calibration of flow meters for RAS, WAS, effluent and chlorine residual meter.

Main plant generator #2 has been repaired. There was a bad circuit board in the control panel which prevented the generator from running as well as a leak at the water pump. The coolant was found to be deteriorated and will need to be replaced.

The Tier 2 report was submitted to DEP Emergency Management for chemicals onsite.

The annual sludge report for sludge disposal has been submitted for this facility