


United Water - AOS
1111 Nantasket Avenue
Hull, Ma 02045-1313
Tel # 781-925-0906
Fax # 781-925-3056

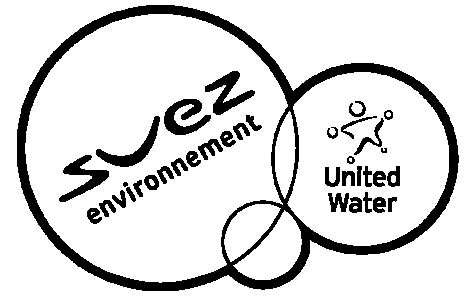

MONTHLY OPERATING REPORT

October 2010

EXECUTIVE SUMMARY

There were no odor reports in the month of October.

All generators have been serviced. This was a major service where oil and filters were changed.

The gas pressure at Station 5 has been adjusted so there is proper pressure to operate the generator and it has been load tested to assure proper operation.

National Watermain initiated there fall cleaning and camera. They will be returning to complete the camera work.

Secondary clarifier #1 was removed from service as it tripped out on torque overload. It was drained and inspected, several bolts were replaced with stainless steel, a broken sludge judge was removed and the unit returned to service.

The wash press that cleans the rags from the step screen has been removed from service for repair. It will require a major overhaul. Parts have been ordered and the manufacturer, Huber, has been requested to provide technical support when the parts arrive for reinstallation.

Cast iron drain piping has been replaced on the second floor by Hoadley Plumbing. The piping was cracked and leaking.